


GENERAL NOTE

- ALL FITTINGS AND LINES TO BE PVC, SOLVENT WELD (SDR-35)
- DEVIDE SHOULD BE INSTALLED AFTER FINAL GRADING HAS BEEN PERFORMED.
- INSPECTION ASSEMBLY TO BE INSTALLED AS REQ'D BY CODE.

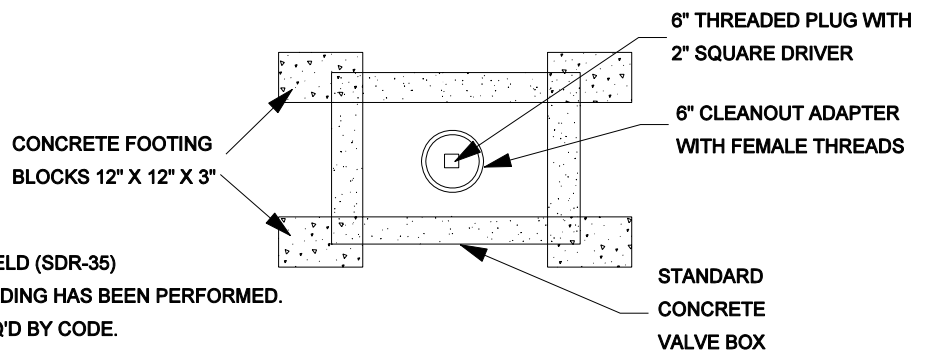

DRAWING NOT TO SCALE

APRIL 24, 2006

DRAWN BY: KMC

APPROVED BY: GH

EXTERIOR SEWER SERVICE CLEANOUT DETAIL

STANDARD
DRAWING NO.

P-3

MURFREESBORO WATER & SEWER DEPARTMENT